



## SUBMITTAL DATA

FXE48HP230V1R32AH / FXU60HP230V1R32AO  
48000 BTU/H Unitary Heat Pump Split System

Job Name	Location	Date
Purchaser	Engineer	
Submmited to	For	
Unit Designation	Schedule No.	

 <p>FXE48HP230V1R32AH</p>	 <p>FXU60HP230V1R32AO</p>
--	--

## GENERAL FEATURES


- AHRI Certificate: [217123258](#)
- High Efficiency DC Inverter Technology
- 24VAC Thermostat Compatible
- Zero Lot Line Design
- Match with GREE or Competitive Indoor Unit
- New R32 Refrigerant
- Designed for New Construction or Replacement Market
- Low Ambient Cooling down to -15°C (5°F)
- Low Ambient Heating down to -30°C (-22°F)
- Coil (Outdoor) Copper Tube/Aluminum Fin with Anti-Corrosion Coil Coating (Gold Colored Fin - 1500Hr Salt Spray Rating)
- Coil (Indoor) Copper Tube/Aluminum Fin with Anti-Corrosion Coil Coating (Blue Colored Fin - 500Hr Salt Spray Rating)

## SPECIFICATIONS, FEATURES & FUNCTION SUMMARY

SYSTEM TYPE			
Outdoor Model			FXU60HP230V1R32AO
Indoor Model			FXE48HP230V1R32AH
SYSTEM PERFORMANCE			
Cooling Capacity	Min - Max	Btu/h	34,000 - 50,000
	Capacity @95°F	Btu/h	48,000
Heating Capacity	Min - Max	Btu/h	25,162 - 50,880
	Capacity @47°F	Btu/h	48,000
	Capacity @17°F	Btu/h	39,500
	Capacity @5°F	Btu/h	48,000
SEER2			19.0
EER2			12.0
HSPF2			10.0
COP @5°F			2.0
			3.3
Cooling Temperature Range		°F	5 - 129
Heating Temperature Range		°F	-22 - 75
Refrigerant Type			R32
INDOOR UNIT		FXE48HP230V1R32AH	
Power Supply		VAC	208-230V / 1Ph / 60 Hz
Sound Pressure Level		dB(A)	53
Control Voltage		VAC	24
Rated Current Cooling		A	19
Rated Current Heating		A	19
MCA		A	7.1
MOCP		A	15
Electric Heater (Optional)		kW	6, 9, 12
Air Flow		CFM	1400
External Static Pressure (Up to)		In W.c.	1.0
Dehumidification		pt/hr	8.49
Drain Piping		in	Φ1×0.05
External Dimensions (W x H x D)		in	24-13/16 × 21-1/4 × 52
Package Dimension (W x H x D)		in	27-1/4 × 26 × 54-3/16
Net Weight		lbs	199.5
Gross Weight		lbs	218.0
OUTDOOR UNIT		FXU60HP230V1R32AO	
Power Supply		VAC	208-230V / 1Ph / 60 Hz
Sound Pressure Level		dB(A)	63
Control Voltage		VAC	24
Rated Current Cooling		A	24.53
Rated Current Heating		A	23.44
MCA		A	40
MOCP		A	45
Compressor Type		GREE G20 / Double Cylinder / 2 - Stage Inverter	
External Dimensions (W x H x D)		in	35-7/16 × 49-5/8 × 13-3/8
Package Dimension (W x H x D)		in	40-11/16 × 55-3/16 × 17-3/8
Net Weight		lbs	241.4
Gross Weight		lbs	263.5
Refrigerant Charge - R32		oz	162.3
Additional Charge		oz/ft	0.215
REFRIGERANT PIPING			
Line Set Size (Liquid - Gas) - Flared Connections		in	3/8 - 3/4
Pre-Charge Length		ft	25
Pipe Length (Min - Max)		ft	10 - 98
Max. Pipe Elevation		ft	49

FEATURES & FUNCTIONS SUMMARY	
Ultra Low Frequency Torque Control	Yes
Power Factor Correction	Yes
Outdoor Electronic Expansion Valve (EEV)	Yes
Indoor TXV Control	Yes
Basepan With Electric Heater	Yes
Compressor With Electric Heater	Yes
Fin Coating (Outdoor - Golden & Indoor - Blue)	Acrylic Resin
Intelligent Defrosting	Yes
Intelligent Preheating	Yes
Low Voltage Startup	Yes
Memory/Power Failure Recovery	Yes
Self Diagnosis	Yes
Low Ambient Cooling	Yes
24VAC Thermostat Compatible	Yes
Indoor Fan Type	Centrifugal
Multi Fan Speeds	5 Speeds
Auxiliary Electrical Heater	Optional

## FAN PERFORMANCE

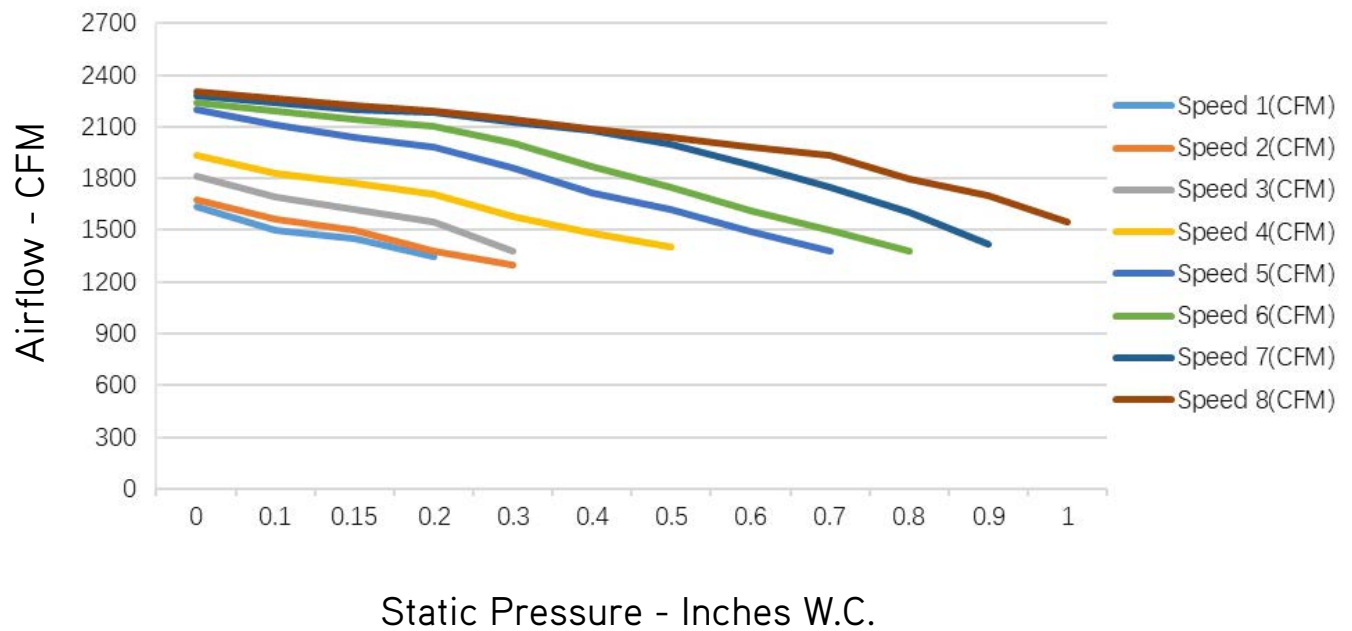

### NOTE:


1. Above chart CFM ratings are based on dry coil with factory filter installed.
2. For wet coil CFM ratings, multiply the CFM by 0.96 correction factor.

DIMENSIONS

INDOOR UNIT

Unit: inch


FXE48HP230V1R32AH	
DIMENSIONS	
A	11-5/8
B	20
H	52
W	24-13/16
D	21-1/4

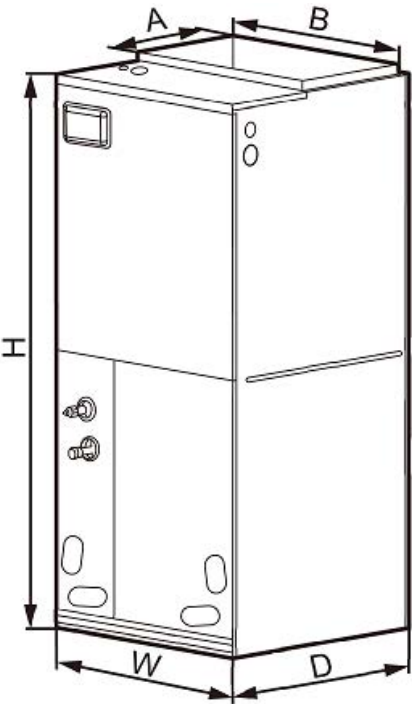


OUTDOOR UNIT

Unit: inch

FXU60HP230V1R32AO	
DIMENSIONS	
A	35-7/16
B	16-1/4
C	49-5/8
D	22-7/16
E	14-7/8
G	13-3/8

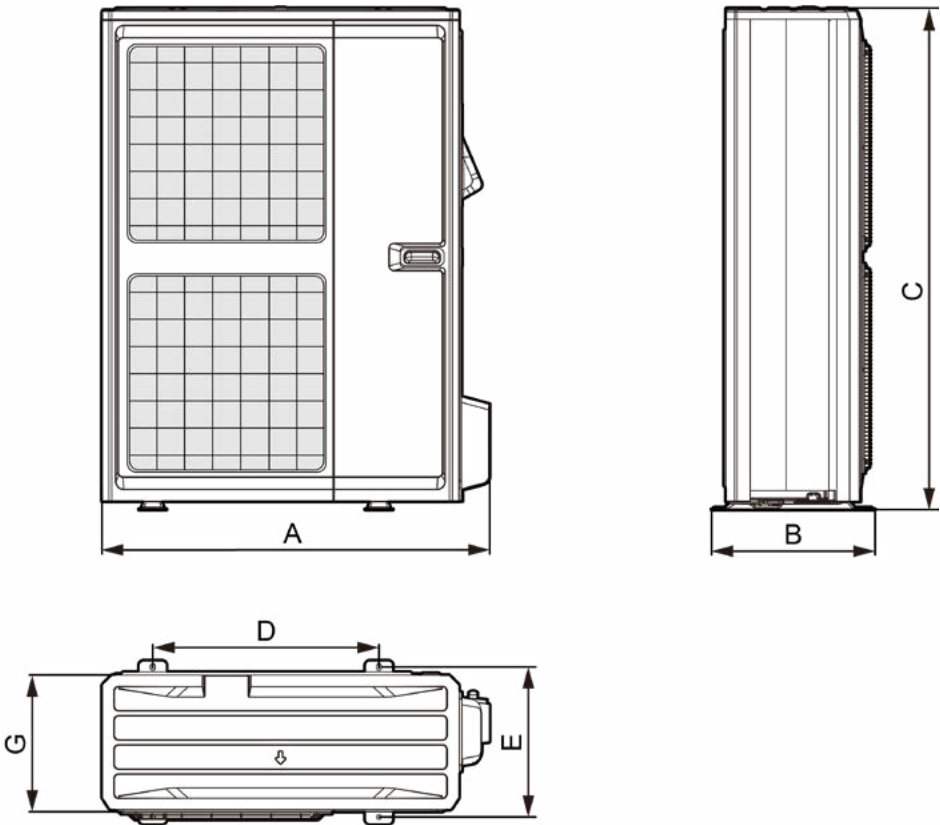

ACCESSORY HEATER AND GENERAL INFORMATION

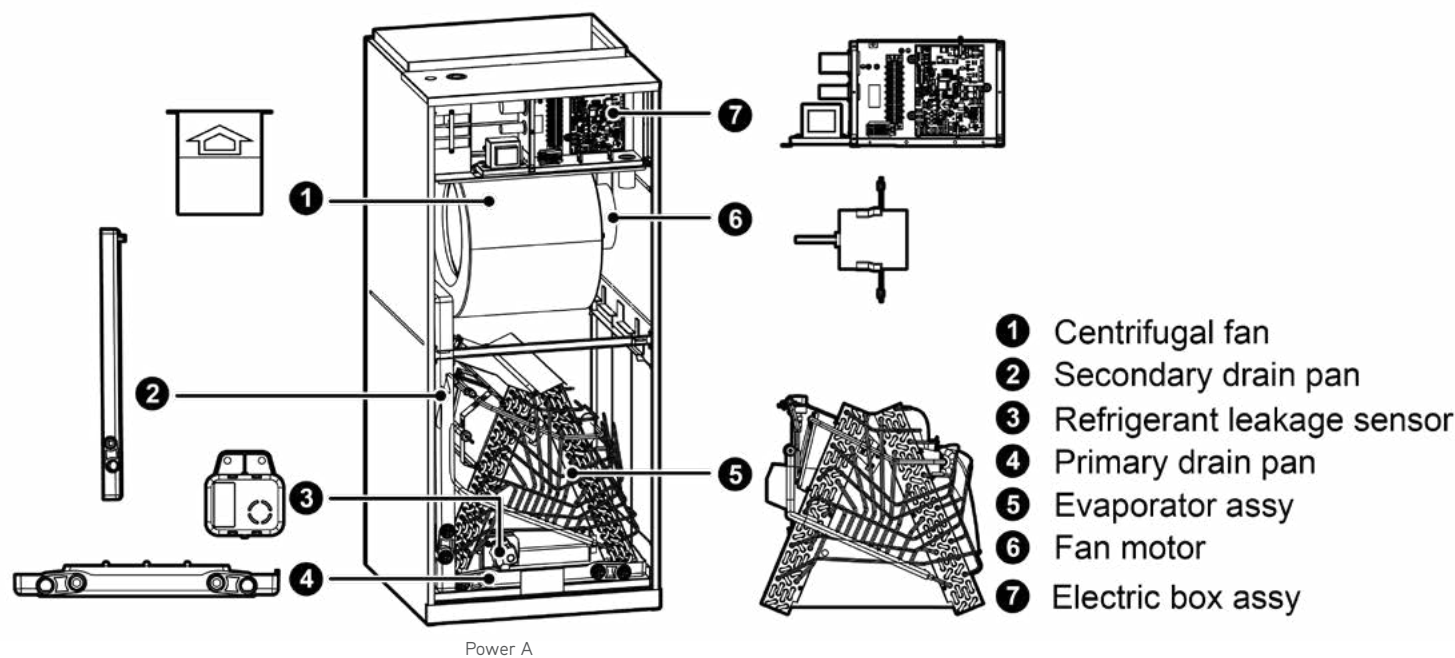

MODEL	Heat Kit Model	Part Number	Electric Heat (kW)		Min. Circuit Ampacity (A)			Max Fuse or Breaker (A)				
			208V	230V	208V	230V	208V	230V	208V	230V		
FXE48HP230V1R32AH	One Mains Supply											
	320004060223	FLEXA2LHTR06	3.74	4.6	31	33	35	35				
	Two Mains Supply											
					Power A	Power B	Power A	Power B	Power A	Power B	Power A	Power B
	320004060224	FLEXA2LHTR09	6.03	7.36	35	13.8	36.9	15	40	15	40	20
	320004060225	FLEXA2LHTR12	7.49	9.2	35	27.5	36.9	30	40	30	40	35



## CLEARANCES

### INDOOR UNIT


Minimum clearance

FRONT

> 24

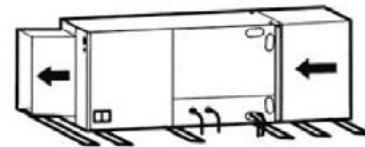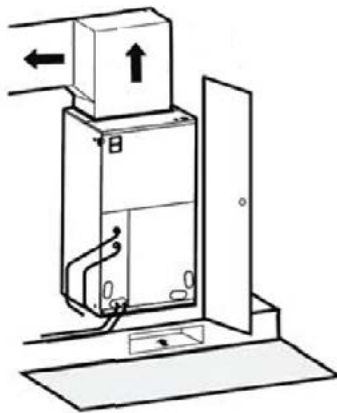

Horizontal Left Configuration - No Modification Needed

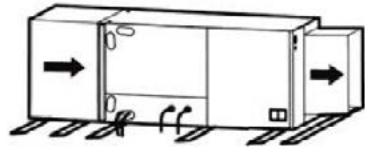

Horizontal Right Configuration - Must Relocate Drain Pan

#### NOTE:

Allow a minimum of 24" in front of the unit for service clearance. When installing in an area directly over a finished ceiling (such as an attic), an emergency drain pan is required directly under the unit. **See local and state codes for requirements.** When installing this unit in an area that may become wet, elevate the unit with a sturdy, non-porous material. In installations that may lead to physical damage (i.e. a garage) it is advised to install a protective barrier to prevent such damage. This air handler is designed for a complete supply and return ductwork system.

### OUTDOOR UNIT


Minimum clearance

#### NOTE:

Install the Outdoor Unit **2 Inches** Above the Expected Snow Line

1. When one outdoor unit is to be installed.


A - E	$H_b$ $H_d$ $H$		(in)				
			a	b	c	d	e
B	-	-	-	$\geq 4$	-	-	-
A, B, C	-	-	$\geq 12$	$\geq 4$	$\geq 4$	-	-
B, E	-	-	-	$\geq 4$	-	-	$\geq 40$
A, B, C, E	-	-	$\geq 12$	$\geq 6$	$\geq 6$	-	$\geq 40$
D	-	-	-	-	-	$\geq 40$	-
D, E	-	-	-	-	-	$\geq 40$	$\geq 40$
B, D	$H_b < H_d$	$H_d < H$	-	$\geq 4$	-	$\geq 40$	-
	$H_b > H_d$	$H_d > H$	-	$\geq 4$	-	$\geq 40$	-
B, D, E	$H_b \leq 1/2H$		-	$\geq 10$	-	$\geq 80$	$\geq 40$
	$H_b < H_d$	$1/2H < H_b \leq H$	-	$\geq 10$	-	$\geq 80$	$\geq 40$
	$H_b > H$		Prohibited				
	$H_b \leq 1/2H$		-	$\geq 4$	-	$\geq 80$	$\geq 40$
	$H_b > H_d$	$1/2H < H_b \leq H$	-	$\geq 8$	-	$\geq 80$	$\geq 40$
	$H_d > H$		Prohibited				

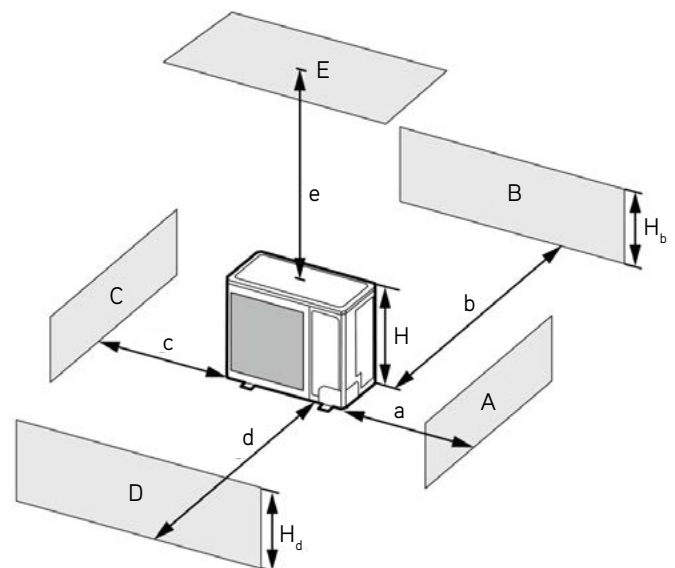

## CLEARANCES


2. When two or more outdoor units are to be installed side by side.

A - E	$H_b$ $H_d$ $H$	(in)				
		a	b	c	d	e
A, B, C	-	$\geq 12$	$\geq 12$	$\geq 40$	-	-
A, B, C, E	-	$\geq 12$	$\geq 12$	$\geq 40$	-	$\geq 40$
D	-	-	-	-	$\geq 80$	-
D, E	-	-	-	-	$\geq 80$	$\geq 40$
B, D	$H_b < H_d$	-	$\geq 12$	-	$\geq 80$	-
	$H_b > H_d$	-	$\geq 10$	-	$\geq 80$	-
B, D, E	$H_b > H_d$	$H_d \leq 1/2H$	-	$\geq 12$	-	$\geq 100$
	$H_b > H_d$	$1/2H < H_d \leq H$	-	$\geq 12$	-	$\geq 80$
	$H_b > H_d$	$H_b \leq 1/2H$	-	$\geq 12$	-	$\geq 80$
	$H_b > H_d$	$1/2H < H_b \leq H$	-	$\geq 12$	-	$\geq 100$
	$H_b > H_d$	$H_b > H$	Prohibited			
	$H_b > H_d$	$H_d \leq 1/2H$	-	$\geq 10$	-	$\geq 100$
	$H_b > H_d$	$1/2H < H_d \leq H$	-	$\geq 12$	-	$\geq 100$
	$H_b > H_d$	$H_d > H$	Prohibited			

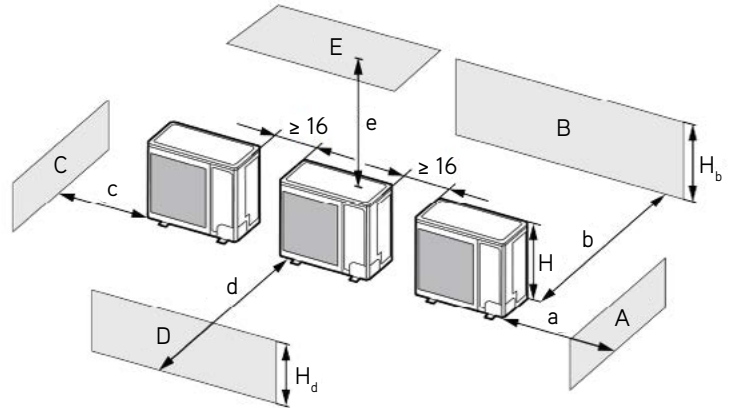

3. When outdoor units are installed in rows.

$H_b$ $H_d$	(in)
$H_b \leq 1/2H$	$b \leq 10$
$1/2H < H_b \leq H$	$b \leq 12$
$H_b > H_d$	Prohibited

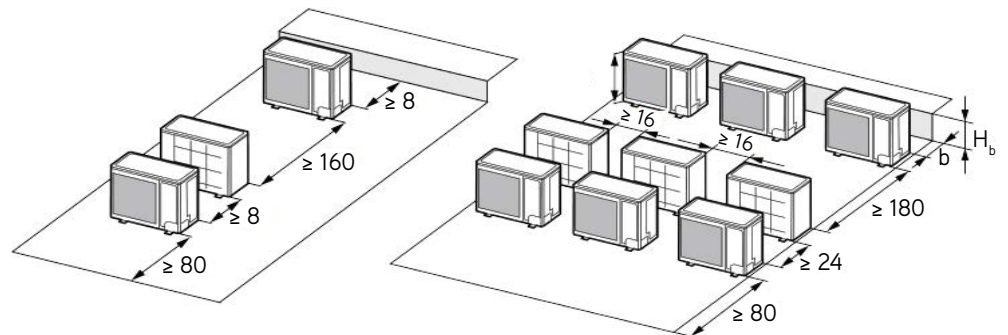

4. When outdoor units are installed one above another.

